

Exhibit 2008

Fundamentals of Automatic Control

Robert C. Weyrick
Community and Technical College
The University of Akron

McGraw-Hill Book Company

New York	Montreal
St. Louis	New Delhi
Dallas	Panama
San Francisco	Paris
Düsseldorf	São Paulo
Johannesburg	Singapore
Kuala Lumpur	Sydney
London	Tokyo
Mexico	Toronto

Class Cataloging in Publication Data

Control of automatic control.

Control. I. Title.

74-10896

-1

ALS OF AUTOMATIC CONTROL

975 by McGraw-Hill, Inc. All rights reserved.

United States of America. No part of this publication

reproduced, stored in a retrieval system, or transmitted, in

any form or by any means, electronic, mechanical, photocopying, recording,

without the prior written permission of the publisher.

DKPKP 78321098765

This book were Alan W. Lowe and
the designer was Tracy A. Glasner,
on was supervised by Valerie Klima and Laurence Charnow.
edallion by York Graphic Services, Inc.
nd bound by Kingsport Press, Inc.

To my mother

TJ
213
W43

134771



Figure 1-8 Takeoff-point representation

as being combined at a summing point must be in the same plane, two voltages may be combined but a voltage and current cannot be brought together. Any number of variables may be combined at a summing point.

A takeoff point is simply represented by a dot as shown in Fig. 1-8.

In the block-diagram representation of a system, let us assume the oven-temperature control described in the preceding section is shown in block-diagram form in Fig. 1-9. In this diagram the various blocks may be identified with elements of a system. In addition the units associated with the transfer function are shown in parentheses.

The diagram tends to clarify the physical understanding of the system and provides a convenient basis for system analysis. We shall use block diagrams as useful in pointing out the similarity between apparently unrelated systems. It should be emphasized that in connecting one block with another represent the flow of information within the system. The main sources of energy for the system need not be included in the block diagram.

1-6 SIMPLIFICATION OF BLOCK DIAGRAMS

A block diagram that is initially drawn for a system may contain a large number of blocks and signal paths and be more complicated than necessary. In such cases a simplification may be performed to rearrange the block diagram to a form with fewer blocks. Rearranging

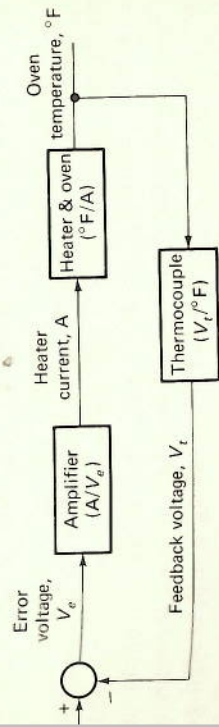


Figure 1-9 Block diagram of oven-temperature control

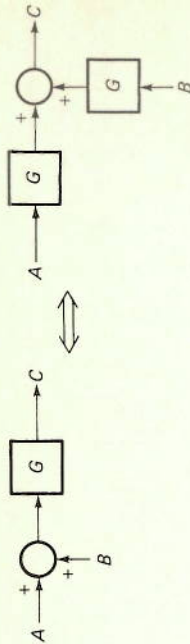


Figure 1-10 Moving summing point around a block

a system diagram to effect simplification is termed block-diagram algebra since it is analogous to simplifying algebraic equations. However, reducing a block diagram has the advantage of providing a better understanding of the interrelationships of the various elements in the system as compared to simplifying the system equations.

The combining of cascaded blocks into a single block, as described in Sec. 1-5, is obviously one step toward simplification. As another possibility, it is sometimes useful to move a summing point around a block as indicated in Fig. 1-10. Note that the inputs A and B are introduced through blocks incorporating the function G around which the summing point was moved. Applying the distributive property of algebra, we see that $C = (A + B)G = AG + BG$. Thus the two diagrams are equivalent.

Table 1-1 gives a number of transformations useful in simplifying block diagrams. These transformations can be verified by showing that the outputs from the two equivalent diagrams are the same. Note that the original and equivalent identities can be used interchangeably.

1-7 CLOSED-LOOP TRANSFER FUNCTION

Since certain functions and types of variables are commonly associated with feedback control systems, a generalized block diagram may be formulated and the associated closed-loop transfer function derived. Some standardization of the symbols and terminology relating to feedback control systems has been achieved and is used in this case.

Figure 1-11 is a general block diagram of a closed-loop control system. It is important that the terms used in this diagram be clearly understood.

System Variables

The desired value V is an external signal applied to the system to command a specific output from the process. The desired value is sometimes called the system command or set point.

TABLE 1-1 BLOCK-DIAGRAM IDENTITIES

Condition	Original	Equivalent
Series blocks		
Parallel blocks		
Summing point block		
Summing point block		
Takeoff point block		
Takeoff point block		
Takeoff point block		
Takeoff point block		
Feedback block		

- G_v Reference input elements
- G_1 Control elements
- G_2 System elements or process
- H Feedback elements
- V Desired value
- R Reference input
- C Controlled output
- M Manipulated variable
- U Disturbance input
- B Feedback signal
- E Error or actuating signal

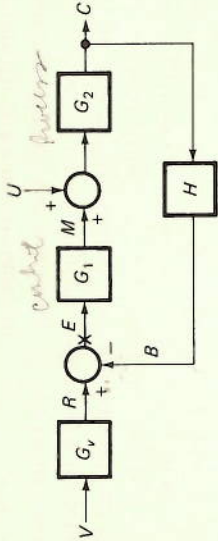


Figure 1-11 General block diagram of control system

The reference input R is derived from the desired value and is a signal external to the control loop. It serves as the reference of comparison for the feedback signal.

The controlled output C is the process quantity being controlled.

The manipulated variable M is the control signal which the control elements apply to the process.

The feedback signal B is a signal which is a function of the controlled output and which is summed with the reference input.

The error or actuating signal E is the algebraic difference between the reference input and feedback signals and provides the signal applied to the control elements.

The disturbance input U is an unwanted input signal to the system that tends to cause the controlled output to differ from the value commanded by the reference input. Disturbance inputs are due to changes in the load on the system. For example, a change in the ambient temperature surrounding the oven described in Sec. 1-3 is a disturbance since it changes the heat input required by the oven. Obviously the response of the system to a disturbance input should be minimal.

System Elements

The reference input elements G_v convert the desired value to a reference input signal.

The control elements G_1 , sometimes called the controller, are the components that act on the error signal and generate a control signal to the process.

The feedback elements H are the components required to measure or sense the value of the controlled output and convert it to a usable feedback signal.