

## Declaration of Rachel J. Watters on Authentication of Publication

I, Rachel J. Watters, am a librarian, and the Head of Resource Sharing for the General Library System, Memorial Library, located at 728 State Street, Madison, Wisconsin, 53706. Part of my job responsibilities include oversight of Wisconsin TechSearch (“WTS”), an interlibrary loan department at the University of Wisconsin-Madison. I have worked as a librarian at the University of Wisconsin library system since 1998, starting as a graduate student employee in the Kurt F. Wendt Engineering Library and WTS, then as a librarian in Interlibrary Loan at Memorial Library. I began professional employment at WTS in 2002 and became WTS Director in 2011. In 2019, I became of Head of Resource Sharing for UW-Madison’s General Library System. I have a master’s degree in Library and Information Studies from the University of Wisconsin-Madison. Through the course of my studies and employment, I have become well informed about the operations of the University of Wisconsin library system, which follows standard library practices.

This Declaration relates to the dates of receipt and availability of the following:

**Han, M.Y., Park, Y.H., and Yu, T.J. (2002). Development of a new method of measuring bubble size. *Water Science and Technology: Water Supply*, 2(2), 77-83.**

Standard operating procedures for materials at the University of Wisconsin-Madison Libraries. When an issue was received by the Library, it would be checked in, stamped with the date of receipt, added to library holdings records, and made available

## Declaration of Rachel J. Watters on Authentication of Publication

to readers as soon after its arrival as possible. The procedure normally took a few days or at most 2 to 3 weeks.

Exhibit A to this Declaration is a true and accurate copy of the title page with library date stamp of *Water Science and Technology: Water Supply* (2002), from the University of Wisconsin-Madison Library collection. Exhibit A also includes an excerpt of pages 77 to 83 of that issue, showing the article entitled *Development of a new method of measuring bubble size* (2002). Based on this information, the date stamp on the journal title page indicates *Development of a new method of measuring bubble size* (2002) was received by the Kurt F. Wendt Library, University of Wisconsin-Madison on May 20, 2002.

Based on the information in Exhibit A, it is clear that the issue was received by the library on or before May 20, 2002, catalogued and available to library patrons within a few days or at most 2 to 3 weeks after May 20, 2002.

Members of the interested public could locate the *Water Science and Technology: Water Supply* (2002) publication after it was cataloged by searching the public library catalog or requesting a search through WTS. The search could be done by title and/or subject key words. Members of the interested public could access the publication by locating it on the library's shelves or requesting it from WTS.


I declare that all statements made herein of my own knowledge are true and that all statements made on information and belief are believed to be true; and further that

Declaration of Rachel J. Watters on Authentication of Publication

these statements were made with the knowledge that willful false statements and the like so made are punishable by fine or imprisonment, or both, under Section 1001 of Title 18 of the United States Code.

Date: December 17, 2020

Memorial Library  
728 State Street  
Madison, Wisconsin 53706

  
\_\_\_\_\_  
Rachel J. Watters  
Head of Resource Sharing





## Editor-in-Chief

**Peter Wilderer** Technical University of Munich, Germany

## Editors

**Erik Arvin** Technical University of Denmark

**Linda Blackall** University of Queensland, Australia

**Mohamed F Hamoda** University of Kuwait

**Peter Steen Mikkelsen** Technical University of Denmark

**Eberhard Morgenroth** University of Illinois at Urbana-Champaign

**Ralf Otterpohl** Technical University of Hamburg-Harburg, Germany

**Marie-Noelle Pons** Institute National Polytechnique de Lorraine, University of Nancy, France

**Wolfgang Rauch** University of Innsbruck, Austria

**Tom Stephenson** Cranfield University, UK

**Zaini Ujang** Universiti Teknologi Malaysia

**Zhu Jianrong** Tsinghua University, China

## Journals Manager

**Paul Nagle**

### Editorial Office

Paul Nagle, IWA Publishing, Alliance House, 12 Caxton Street, London SW1H 0QS, UK

Telephone: +44 (0)20 7654 5500

Fax: +44 (0)20 7654 5555

E-mail: pnagle@iwap.co.uk

www.iwapublishing.com

## Aims and Scope

*Water Science and Technology: Water Supply* publishes the selected proceedings of IWA conferences, symposia and workshops. All papers have been selected for publication after refereeing under the auspices of the conference editor(s) and the Programme Committee for each IWA event, and after review by a member of the board of editors.

*Water Science and Technology: Water Supply* incorporates the journal *Water Supply* (ISSN 0735-1917) formerly published by the International Water Services Association.

## Copyright © 2002 IWA Publishing

Except as otherwise permitted under the Copyright, Designs and Patents Act, 1988, this publication may only be reproduced, stored or transmitted, in any form or by any other means, with the prior permission in writing of the publisher, or in the case of xerographic reproduction, in accordance with the terms of a licence issued by the Copyright Licence Agency. In particular, IWA Publishing permits the making of a single photocopy of an article from this issue (under sections 29 and 38 of this Act) for an individual for the purposes of research or private study.



This paper meets the requirements of ISO 9706:1994. *Information and documentation – Paper for documents – Requirements for permanence.*

Cover and text design by Smith & Gilmour, London, UK. Typeset and printed by J W Arrowsmith Ltd, Bristol, UK.

**Water Science & Technology: Water Supply**  
**2nd World Water Congress: Drinking**  
**Water Treatment**

KURT F. WEIDEN  
COLLEGE OF ENGINEERING

MAY 20 2002

MADISON

# Contents

## Micropollutants and drinking water perspective

- 1 **New approaches for structural characterization of organic matter in drinking water and wastewater effluents** J.E. Drewes and J.-P. Croue
- 11 **A systems analysis comparing drinking water systems – central physical-chemical treatment and local membrane filtration** T. Westrell, O. Bergstedt, G. Heinicke and E. Kärrman
- 19 **Pharmaceuticals degradation by UV and UV/H<sub>2</sub>O<sub>2</sub> treatments** A. Bozzi, A. Lopez, G. Mascolo and G. Tiravanti
- 27 **The removal of Cu (II), Cd (II), Ni (II) and Pb (II) from dilute aqueous solution by a poly(acrylic acid) flocculant and its cross-linked analogue** C. Morlay, Y. Mouginot, M. Cromer and O. Vittori
- 35 **A hybrid biofilm reactor for nitrate and pesticide removal** Y. Sakakibara, Z. Feleke and T. Katahira
- 43 **Drinking water quality assessment practices: an international perspective** M.C. Steynberg
- 51 **Sequential anaerobic/aerobic biodegradation of chlorinated hydrocarbons in activated carbon barriers** A. Tiehm, M. Gozan, A. Müller, H. Schell, H. Lorbeer and P. Werner
- 59 **In the (adsorption) competition between NOM and MIB, who is the winner, and why?** G. Newcombe, J. Morrison, C. Hepplewhite and D.R.U. Knappe

## Particle separation

- 69 **Flow structures in a dissolved air flotation pilot tank and the influence on the separation of MBBR floc** M. Lundh, L. Jönsson and J. Dahlquist
- 77 **Development of a new method of measuring bubble size** M.Y. Han, Y.H. Park and T.J. Yu
- 85 **Fate and removal of *Cryptosporidium* in a dissolved air flotation water plant with and without recycle of waste filter backwash water** J.K. Edzwald and J.E. Tobiason
- 91 **Investigations on the filtration of natural aquatic suspensions supported by dosing small amounts of Fe(III)-salts ( $\beta_{Fe} \leq 0.1 \text{ mg L}^{-1}$ ): mode of action and basic design criteria** R. Winzenbacher, R. Schick, H.-H. Stabel and M. Jekel
- 99 **Structure of Al-humic flocs and their removal at slightly acidic and neutral pH** X.C. Wang, P.K. Jin and J. Gregory
- 107 **A pilot plant study of polysilicato-iron coagulant** J. Wang, P. Deevanhxay, T. Hasegawa, Y. Ehara, M. Kurokawa, K. Hashimoto, W. Nishijima and M. Okada
- 115 **Characterization and destabilization of spent filter backwash water particles** A. Adin, L. Dean, F. Bonner, A. Nasser and Z. Huberman

## Full-scale studies

- 123 **System development and testing of wind-powered reverse osmosis desalination for remote Pacific islands** C.C.K. Liu, R. Migita and J.-W. Park
- 131 **Optimisation of coagulation and chlorination in drinking water treatment: laboratory and full-scale studies** N.D. Basson and C.F. Schutte
- 139 **Addressing the sustainability of small-user rural water treatment systems in South Africa** G.S. Mackintosh, P.F. de Souza and E. Delpont

- 145 **Using percentile analysis for determination of alarm values** R.C. Lake, P.A. Agutter and T. Burke

### **Pilot and bench-scale studies**

- 151 **Determination of mass transport characteristics for natural organic matter (NOM) in ultrafiltration (UF) and nanofiltration (NF) membranes** S. Lee, Y. Shim, I.S. Kim, J. Sohn, S.K. Yim and J. Cho
- 161 **Removal of nitrate from water in a novel ion exchange membrane bioreactor** S. Velizarov, J.G. Crespo and M.A. Reis
- 169 **Ammonia oxidation at low temperature in a high concentration powdered activated carbon membrane bioreactor** G. Seo, S. Takizawa and S. Ohgaki
- 177 **Performance and membrane foulant in the pilot operation of a novel biofilm-membrane reactor** K. Kimura and Y. Watanabe
- 185 **Pilot plant study on the performance and optimization of submerged membranes for taste and odor removal** L. Schideman, V.L. Snoeyink, B.J. Mariñas and M. Kosterman
- 193 **Biofilter pretreatment for the control of microfiltration membrane fouling** J. Park, S. Takizawa, H. Katayama and S. Ohgaki
- 201 **The effect of various operating conditions and water quality parameters on the removal of perchlorate in a biologically active carbon filter** J.C. Brown, V.L. Snoeyink, L.M. Raskin, J.C. Chee-Sanford and R. Lin
- 207 **Denaturing gradient gel electrophoresis analysis of a methyl *tert*-butyl ether degrading culture applied in a membrane bioreactor** A. Pruden, M. Suidan, J. Morrison and A. Venosa

### **Treatment of groundwater**

- 213 **Improved ultraviolet spectrophotometric method for determination of nitrate in natural waters** N. Kishimoto, I. Somiya and R. Taniyama
- 223 **Influence of gasoline hydrocarbons on methyl *tert*-butyl ether biotreatment in fluidized bed bioreactors** W.T. Stringfellow and K.-C. Oh
- 229 **Fenton process for the combined removal of iron and organic micropollutants in groundwater treatment** G.F. Ijpelaar, M. Groenendijk, J.C. Kruitthof and J.C. Schippers
- 237 **Arsenic removal by iron hydroxides, produced by enhanced corrosion of iron** K. Karschunke and M. Jekel
- 247 **Characterisation of coated sand from iron removal plants** S.K. Sharma, B. Petrushevski and J.C. Schippers
- 259 **Perchlorate as a secondary substrate in a denitrifying, hollow-fiber membrane biofilm reactor** R. Nerenberg and B.E. Rittmann

### **Arsenic removal**

- 267 **Concept for an integrated evaluation of arsenic removal technologies: demonstrated in a case study** A. Ruhland and M. Jekel
- 275 **Arsenic removal – experience with the GEH® process in Germany** W. Driehaus
- 281 **A low cost technique of arsenic removal from drinking water by coagulation using ferric chloride salt and alum** M.M.T. Khan, K. Yamamoto and M.F. Ahmed

### **Innovative membrane processes**

- 289 **Large scale pilot plant for treating flocculated reservoir water and membrane integrity monitoring** G. Hagemeyer, R. Gimbel and W. Dautzenberg
- 297 **Hydraulic distribution of water and air over a membrane module using AirFlush®** J.Q.J.C. Verberk, P.E. Hoogeveen, H. Futselaar and J.C. van Dijk
- 305 **Effects of particle size distribution on the cake formation in crossflow microfiltration** S. Kim, S.-H. Cho and H. Park



## Development of a new method of measuring bubble size

M.Y. Han\*, Y.H. Park\* and T.J. Yu\*\*

\* School of Civil, Urban & Geosystem Engineering, Seoul National University, San 56-1, Shilim-dong, Kwanak-gu, Seoul, Korea. (E-mail: myhan@gong.snu.ac.kr; yhpark@waterfirst.snu.ac.kr)

\*\* Department of Civil and Environmental Engineering, Kwangju University, 592-1, Jinwol-dong, Nam-gu, Kwangju, Korea. (E-mail: tju@hosim.kwangju.ac.kr)

**Abstract** The use of bubbles in water and wastewater treatment, including dissolved air flotation (DAF) and electro-flotation (EF), is attracting much interest recently. These flotation processes are governed by characteristics of the bubbles as well as the particles, and therefore it is necessary to investigate the size distribution of the bubbles that are generated. In this research, a new method has been developed to measure the bubble size, using commercially available batch-type and on-line particle counters. The results are compared with the traditional image analysis method. Although there are some discrepancies, the results show that an on-line particle counter can produce reasonably accurate size distributions conveniently and efficiently. The bubble size measurement technique developed in this study will assist understanding and improvement of the DAF and EF processes, from both theoretical and practical points of view.

**Keywords** Bubble size; dissolved air flotation (DAF); electro-flotation (EF); image analysis; particle counter

### Introduction

The use of bubbles in water and wastewater treatment, including dissolved air flotation (DAF) and electro-flotation (EF), has attracted much interest recently. Although the fundamental characteristics of the micro-bubble/particle/solution system should affect the removal efficiency of the process, the effect of each governing physical-chemical parameter has not been investigated fully, either experimentally or theoretically. According to recent modeling of the DAF process, the most important parameters that affect the removal efficiency are the size and zeta potential of both bubbles and particles (Han *et al.*, 2001; Han, 2002).

In DAF, bubbles are generated when air-saturated water is released into atmospheric pressure. The size of bubbles is mostly affected by pressure difference across the injection system and type of nozzle (AWWA, 1999). The size range is generally reported to be 10–100  $\mu\text{m}$ , with the average being approximately 40  $\mu\text{m}$ , under a pressure of 4–6 atmospheres (Edzwald, 1995). In EF, hydrogen and oxygen bubbles are generated when current is applied to the solution through metal electrodes. The average size range is reported to be around 20–40  $\mu\text{m}$ , which is a smaller range than that of DAF (Burns *et al.*, 1997).

Several methods have been developed to measure the size of bubbles. The most straightforward method is image analysis. Because this method requires a complicated experimental setup and is time-consuming, it is not easy to produce enough data to generate size distributions under different conditions. Another method is to measure the rising velocity of the bubbles and to calculate the sizes by Stokes' Law. However, because the sizes of bubbles are not uniform, and because the rising velocity of many bubbles is different from that of a single bubble, no general equations are available to predict the size distribution of bubbles from the rising velocities.

In this study, a new method to measure the size of bubbles, using particle counters, was developed. The bubble counting results obtained from both image analysis and particle

counters are compared by measuring the bubbles that are generated under the same conditions in DAF and EF.

## Methods

### Bubble generation conditions

**Dissolved-air-flotation.** Air was pressurized and dissolved into water under 6 atm. To reduce interference from particles of solids, distilled and deionized water was used. Although particles smaller than 10  $\mu\text{m}$  can be detected by the particle counter, only those larger than 10  $\mu\text{m}$  were regarded as bubbles. To avoid over-counting the larger bubbles formed by bubble coalescence inside the tubing, the observations were made directly after the valve. Only a small volume of bubbles was generated to avoid the possibility that a high concentration might decrease the accuracy of the particle counters and increase bubble coalescence.


**Electro-flotation.** To generate bubbles by EF, distilled and deionized water (as above) was mixed with the same volume of tap water. Aluminium electrodes 5 cm square and of thickness 0.5 mm were used, and a DC voltage of 12 V was applied. The method relies on generation of hydrogen bubbles from the cathode. When aluminium electrodes are used,  $\text{Al}^{3+}$  ions and oxygen bubbles are generated from the anode. The aluminium ions hydrolyze in water, producing floc particles that interfere with the measurements of bubble size. To avoid this, the anode was wrapped with GF/C filters (pore size: 0.45  $\mu\text{m}$ ) to prevent floc particles and oxygen bubbles being introduced into the sampling tube.

### Bubble size measurement


**Image analysis.** The image analysis system, which is illustrated in Figure 1, includes a measuring cell, a microscope, a CCD camera, and a computer for image processing.

Bubbles were generated inside the measuring cell to prevent the change of bubble size when bubbles are introduced into the cell through a tube in both DAF and EF. Images of bubbles were taken using the CCD camera. Their sizes were measured using a micrometer. The upper part of the cell was kept open because the pressure difference inside the cell can affect the bubble size. The microscope was focused at the point directly after the valve in DAF and directly above the cathode in EF.

**Batch-type particle counters.** A batch-type particle counter (Multisizer II, Coulter) was used to measure the sizes of bubbles. Figure 2 shows the configuration of the measuring cell

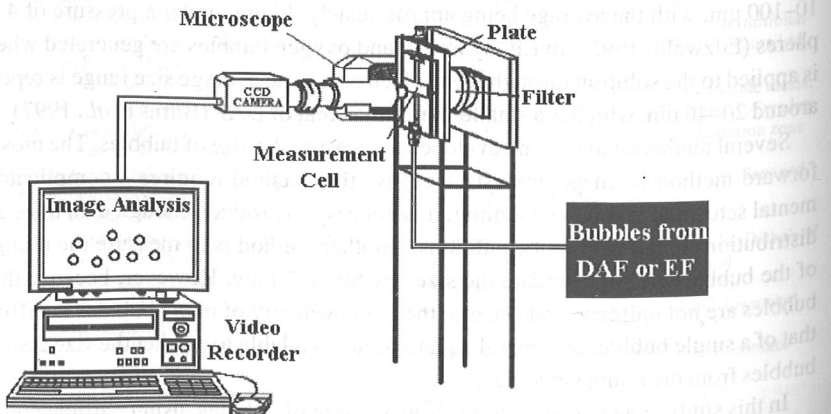


**Figure 1** Image analysis system

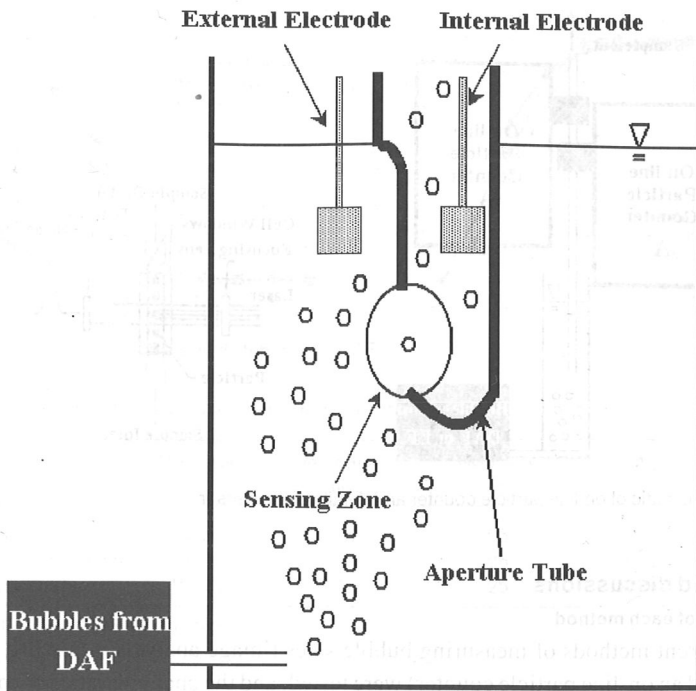

**Figure 2** Schematic of batch-type particle counter

of the Multisizer II. Bubbles generated inside the cell were introduced through the opening in the aperture. An aperture size of  $200\ \mu\text{m}$  was used in the experiment. In this method, a constant electric current passes between the two electrodes through the electrolyte. When particles (bubbles in this research) pass through the sensing zone, the electrolyte volume decreases, which increases the resistance to the electric current. The amount of resistance is exactly proportional to the volume of particles, and this volume is converted to the size of equivalent spherical particles or bubbles. Although the result might be considered accurate because of the narrowly divided channel (256 channels), the application is limited to laboratory experiments because sampling and measuring is quite difficult. Furthermore, bubbles generated by EF cannot be measured, because of the electrical disturbance to the measuring system.

*On-line particle counters.* An on-line particle counter (Chemtrac Model PC2400 D, USA) was used to measure the sizes of bubbles. In this method, a laser light shines through the sensor onto the detector. When the sample passes through the sensor, the light is scattered and obscured by the particles. This scattering and obscuring of the light causes a decrease in the intensity of the light reaching the detector that is proportional to the particle size. According to the decrease, a voltage pulse is generated. Here, the number of pulses represents the number of particles, and the height of the pulse the size of the particles. This instrument can measure over the size range of  $2\text{--}400\ \mu\text{m}$  in seven user-definable size ranges. In this research, two identical particle counters were used to record data for 14 channels. To minimize possible bubble coalescence inside the tube, a straight tube, which was kept as short as possible, was used, and the sampling flow rate was kept at  $100\ \text{ml/min}$  which is recommended by the manufacturer.

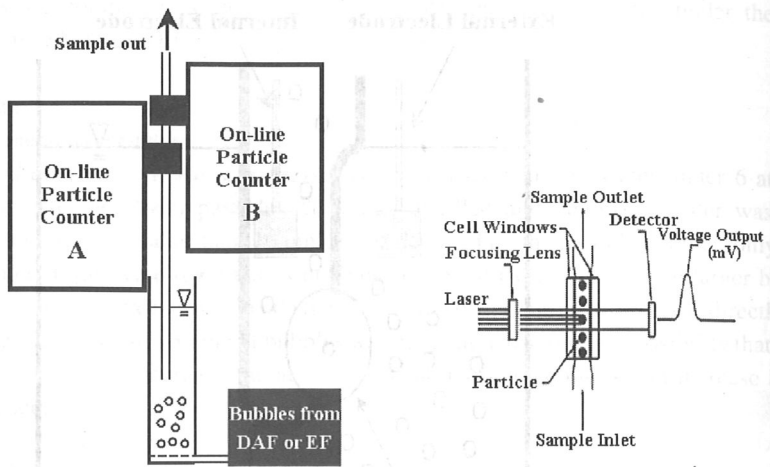

**Figure 3** Schematic of on-line particle counter and details of the sensor

## Results and discussions

### Comparison of each method

Three different methods of measuring bubble sizes (image analysis, a batch-type particle counter, and an on-line particle counter) were tested, and the characteristics of each method are compared in Table 1. The batch-type particle counter is not suitable for bubbles generated by EF. Continuous size measurement is not possible using the image analysis method and the batch-type particle counter.

However, the results are much more accurate than those from the on-line particle counter. The most useful feature of the on-line particle counters is the very rapid rate at which data can be acquired. The time needed to measure 2,000 bubbles by each method was 3,000, 30, and 10 minutes, respectively.

### Bubble size in DAF

The size and size distribution of bubbles generated from DAF were measured by image analysis, batch and online particle counters, respectively. It is important to keep the pressure constant (6 atm.) throughout the DAF experiments, because the size of the bubbles is dependent on the pressure. The results from each method are comparable, as illustrated in Figure 4 and listed in Table 2.

The average bubble size and modal bubble size recorded by each method was similar, but the size range was not. The size range of bubbles from particle counting methods is wider than from image analysis, which means that a small number of larger bubbles was detected in the particle counting methods. One possible reason for this might be the coalescence of bubbles during transport to the sensor. Another reason, applicable to the on-line particle counter, is possible overlapping of bubbles inside the sensor, which would result in counting fewer but larger bubbles. This is an inherent shortcoming of the instrument.

**Table 1** Comparison of characteristics of bubble size measurement methods

	Application		On-line measurement	Size accuracy	Measuring time (min)*
	DAF	EF			
Image analysis	O	O	X	Excellent	3000
Batch-type particle counter	O	X	X	Excellent	30
On-line particle counter	O	O	O	Good	10

\* For measurement of approximately 2,000 bubbles



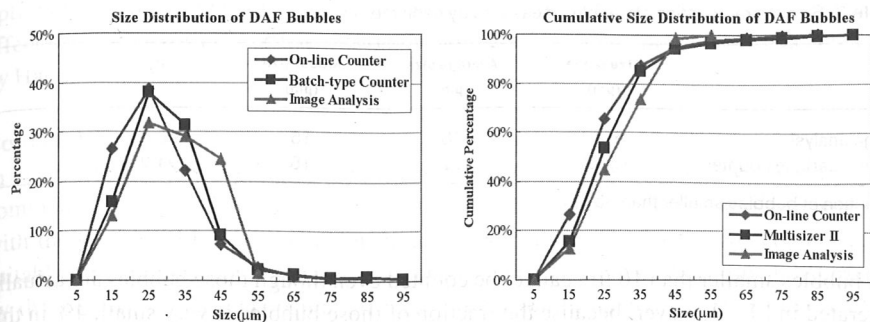


Figure 4 Comparison of bubble size distribution of DAF

Table 2 Size characteristics of bubbles measured by each method

	Size range ( $\mu\text{m}$ )	Average size ( $\mu\text{m}$ )	Modal size ( $\mu\text{m}$ )	$d_{55}^*$
Image analysis	14–56	32	25	99.0%
Batch-type particle counter	13–96	31	25	99.0%
On-line particle counter	15–85	28	25	97.6%

\* Fraction of bubbles smaller than 55  $\mu\text{m}$

Nevertheless, the fraction of bubbles smaller than 55  $\mu\text{m}$  ( $d_{55}$ ) in all measurements is more than 97%, so that the difference in size range is of little importance.

From this comparison, the accuracy of measuring bubbles generated from DAF by a particle counter is considered good enough to be used for process monitoring. The fast response of the on-line particle counter is an especially good feature.

#### Bubble size in EF

Both the image analysis method and the on-line particle counting method were used to measure the size of hydrogen bubbles generated from EF. The batch-type particle counting method cannot be used for EF, as described previously. The size distribution and cumulative distribution of bubbles are compared in Figure 5. The average size, modal size, and size range of bubbles are compared in Table 3.

As the result of DAF experiments, a wider bubble size range was observed for the on-line particle counter compared with image analysis. The reason for this is expected to be the same as with DAF. The difference between the two methods for average bubble size and  $d_{35}$  is slightly larger than observed for DAF. This is because of disturbance by the floc particles produced during electrolysis. Another error in the application of the new method in EF is

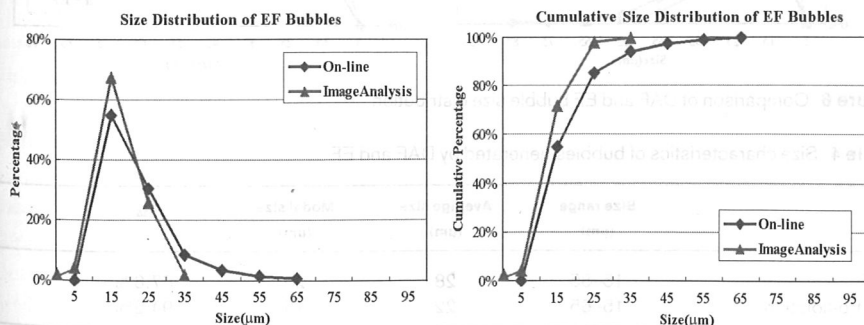


Figure 5 Comparison of bubble size distribution of EF

**Table 3** Size characteristics of bubbles measured by each method

	Size range ( $\mu\text{m}$ )	Average size ( $\mu\text{m}$ )	Modal size ( $\mu\text{m}$ )	$d_{35}$ *
Image analysis	5–40	18	15	99.6%
On-line particle counter	15–65	22	15	94.2%

\* Fraction of bubbles smaller than 35  $\mu\text{m}$

that bubbles smaller than 10  $\mu\text{m}$  cannot be counted even though those bubbles are actually generated in EF. However, because the fraction of those bubbles is very small, 4% in this study, the new method is considered to be quite acceptable also in EF in spite of these problems.


#### Bubble size comparison between DAF and EF

Since it is found from above experiments that the on-line particle counting method can produce data of reasonable accuracy, the sizes of bubbles generated from DAF and EF are compared as in Figure 6 and Table 4.

The size of bubbles produced in DAF is in the range of 15–85  $\mu\text{m}$  and the average size is around 28  $\mu\text{m}$ , whereas the size produced by EF is in the range of 15–65  $\mu\text{m}$  and the average is 22  $\mu\text{m}$ . This result supports the generally known fact that DAF generates larger bubbles than EF does.

The average size of the bubbles produced by DAF in this work is smaller than those sizes reported in the literature. The reason is that in this study the bubbles are measured immediately after release from a 6 atm pressure vessel. Literature values are measured from a contact zone in an operating DAF plant in which the pressures are reduced by passage through piping, valve, and orifice. Lower pressures tend to increase the size of the bubbles. In addition, because the chance of bubble coalescence increases with the time between generation and measurement, the size of bubbles will increase.

In practice, it has been a generally accepted concept that smaller bubbles are preferred in order to achieve a larger bubble surface area and so to maximize mass transfer. However, if the collision and attachment mechanisms are considered in DAF and EF processes, the

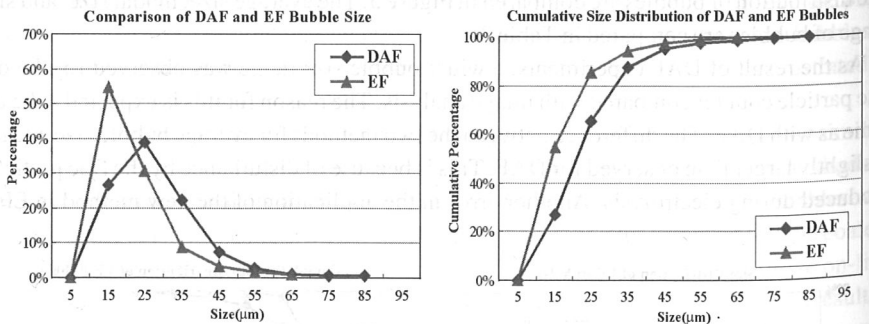**Figure 6** Comparison of DAF and EF bubble size distribution**Table 4** Size characteristics of bubbles generated by DAF and EF

	Size range ( $\mu\text{m}$ )	Average size ( $\mu\text{m}$ )	Modal size ( $\mu\text{m}$ )	$d_{35}$ *
DAF	15–85	28	25	87.6%
Electro-flotation	15–65	22	15	94.2%

\* Fraction of bubbles smaller than 35  $\mu\text{m}$

optimum size of bubbles should be dependent on the size of particles to be removed. The effect of bubble size and particle size on the collision efficiency in DAF has been modeled by Han (2001).

## Conclusion

In this research, a new method to measure bubble size distribution was developed by using commercially available batch-type and on-line particle counters. The results compare well with the traditional but laborious image analysis method. The batch-type counter is not suitable for measurement of the size of bubbles generated from EF because of disturbance by the EF electric current. Although there are some discrepancies, the on-line particle counter can produce reasonably accurate results in a very short time.

The bubble counting method described in this paper will be helpful for research in DAF and EF processes, either theoretically or practically. The mechanism of bubble and particle collision and its effect on the removal efficiency can be described. An optimum operating condition of the bubble generation system and/or pretreatment system can be diagnosed by measuring the size of bubble at several places in the reactor and processes.

## Acknowledgement

The authors wish to acknowledge J. Lee (Seoul National University) for the contribution and assistance during the experiment. This work is funded by MOCT under the project, 2001-JAYU A09.

## References

- Water Quality and Treatment 5th Ed.* (1999). American Water Works Association, McGraw Hill, USA.
- Burns, S.E., Yiacoumi, S. and Tsouris, C. (1997). Microbubble Generation for Environmental and Industrial Separations, Separation and Purification Technology 11, 221–232.
- Edzwald, J. (1995). Principles and Applications of Dissolved Air Flotation. *Wat. Sci. & Tech.*, **31**(3–4), 1–23.
- Han, M.Y. (2002). Modeling of DAF: the effect of particle and bubble characteristics, *Journal of Water Supply: Research and Technology – AQUA* **51** 27–34.
- Han, M.Y., Kim, W.T. and Dockko, S. (2001). Collision Efficiency Factor of Bubble and Particle ( $\alpha_{bp}$ ) in DAF: Theory and Experimental Verification, *Wat. Sci. & Tech.*, **43**(8), 139–144.